
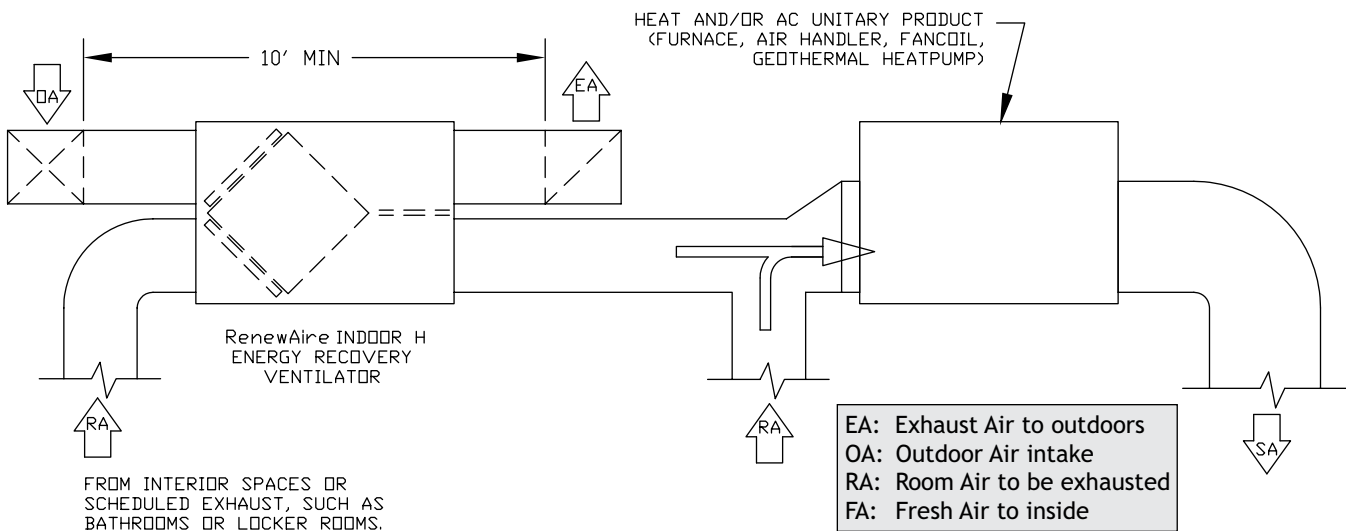
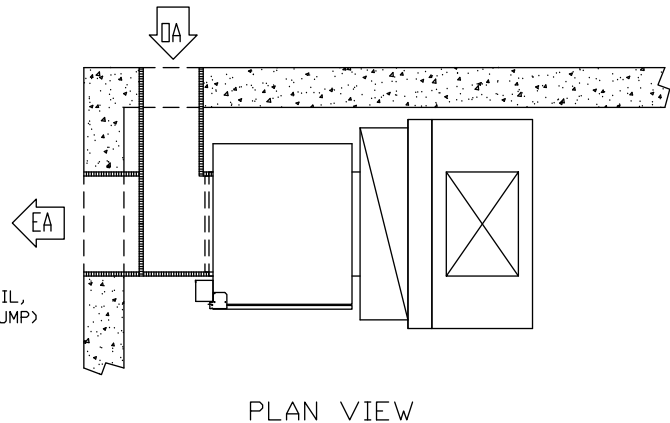


- Horizontal and vertical configuration.
- Wide range of airflow and static capacities.
- AHRI certified performance data for efficiency and cross leakage.
- UL tested flammability and smoke generation that meets NFPA 90A and 90B test standards for commercial applications.
- Easy installation and service.
- Ten year core warranty.

RenewAire means *Trouble-Free* ERV.

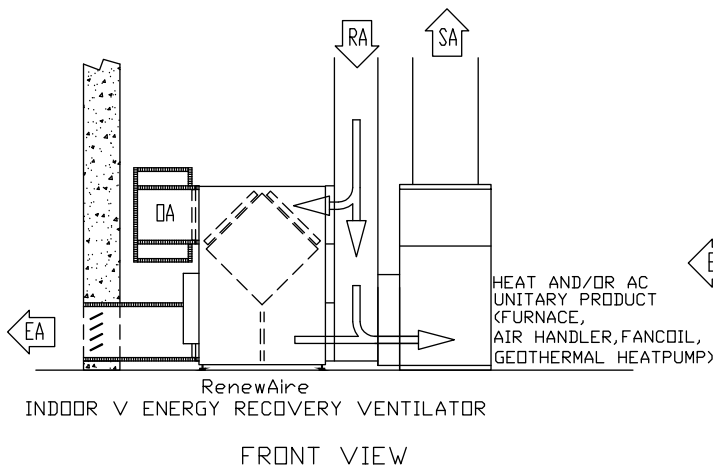

Packaged Indoor Energy Recovery Ventilators: EV450IN, HE1XIN, HE2XIN, HE3XIN, HE4XIN, HE6XIN, HE8XIN

Part I - General

A. Product Specification

1. Energy Recovery Ventilator (ERV) shall be a packaged unit as manufactured by RenewAire and shall transfer both heat and humidity using static plate core technology.

B. Quality Assurance

1. The energy recovery cores used in these products shall be third party Certified by AHRI under its Standard 1060 for Energy Recovery Ventilators. AHRI published certifications shall confirm manufacture's published performance for airflow, static pressure, temperature and total effectiveness, purge air (OACF) and exhaust air leakage (EATR). Products that are not currently AHRI Certified will not be accepted.

2. Manufacturer shall be able to provide evidence of independent testing of the core by Underwriters Laboratory (UL), verifying a maximum flame spread index (FSI) of 25 and a maximum smoke developed index (SDI) of 50 thereby meeting NFPA 90A and NFPA 90B requirements for materials in a compartment handling air intended for circulation through a duct system. The method of test shall be UL Standard 723.

3. Unit shall be Listed under UL 1812 Standard for Ducted Air to Air Heat Exchangers. (Note that a few low volume product or product configurations are not UL Listed.)

4. The ERV core shall be warranted to be free of manufacturing defects and to retain its functional characteristics, under circumstances of normal use, for a period of ten years from the date of purchase. The balance-of-unit shall be warranted to be free of manufacturing defects and to retain its functional characteristics, under circumstances of normal use, for a period of two years from the date of purchase.

Part II - Performance

A. Energy Transfer

The ERV shall be capable of transferring both sensible and latent energy between airstreams. Latent energy transfer shall be accomplished by direct water vapor transfer from one airstream to the other, without exposing transfer media in succeeding cycles directly to the exhaust air and then to the fresh air.

B. Passive Frost Control

The ERV core shall perform without condensing or frosting under normal operating conditions (defined as outside temperatures above -10°F and inside relative humidity below 40%). Occasional more extreme conditions shall not affect the usual function, performance or durability of the core. No condensate drains will be allowed.

C. Continuous Ventilation

Unit shall have the capacity to operate continuously without the need for bypass, recirculation, pre-heaters or defrost cycles under normal operating conditions.

D. Positive Airstream Separation

Water vapor transfer shall be through molecular transport by hydroscopic resin and shall not be accomplished by "porous plate" mechanisms. Exhaust and fresh airstreams shall travel at all times in separate passages and airstreams shall not mix.

E. Laminar Flow

Airflow through the ERV core shall be laminar over the products entire operating airflow range, avoiding deposition of particulates on the interior of the energy exchange plate material.

Part III - Product

A. Construction

1. The energy recovery component shall be of fixed-plate cross-flow construction, with no moving parts.

2. No condensate drain pans or drains shall be allowed and unit shall be capable of operating in both winter and summer conditions without generating condensate.

3. The unit case shall be constructed of G90 galvanized, 20-gauge steel, with lapped corners and zinc plated screw fasteners.

4. Access doors shall provide easy access to blowers, ERV cores and filters. Doors shall have an airtight compression seal using closed cell foam gaskets.

5. Case walls and doors shall be insulated with 1 inch, 4 pound density, foil/scrim faced, high-density fiberglass board insulation, providing a cleanable surface and eliminating the possibility of exposing the fresh air to glass fibers.

6. The ERV cores shall be protected by a MERV-8 rated, 2" nominal, pleated, disposable filter in both airstreams.

7. Unit shall have single-point power connection and a single-point 24 VAC contactor control connection (except Inverter Ready units that have terminal connections for an independent inverter for each airstream).

8. Blower motors shall be EPACT compliant for energy efficiency and be thermally protected or supplied with external starters.

9. Blowers shall be quiet running, forward curve type and be either direct drive or belt drive. HE6X and HE8X units use backward incline, belt drive blower packages. Belt drive motors shall be provided with adjustable pulleys and motor mounts allowing for proper belt tensioning.

B. Options (Select options based on application requirements.)

1. Provide unit and duct connection orientation per project schedule.

2. Provide double wall construction with 24-gauge galvanized steel liner.

3. Units are available single or three phase at a full range of operating voltages. See project schedule.

4. Provide motor horsepower as specified in project schedule.

5. Provide "inverter-ready" units which include shielded power wiring and terminal connections for inverters (inverters provided and installed by others).

6. Provide factory installed fused disconnects.

7. Provide factory installed non-fused disconnects.

8. Provide factory installed transformer/relay package to supply a 24 VAC power source.

9. Provide factory installed filter monitors for each airstream.